

Proposed Conditions

Prepared by Allen & Major Associates

HydroCAD® 9.10 s/n 02881 © 2009 HydroCAD Software Solutions LLC

Post-Development Condition
Type III 24-hr 25-Year Rainfall=5.45"

Printed 8/3/2012

Page 35

Summary for Subcatchment 13S: P-100 - Undeveloped Area

Existing watershed at Equipment Service station


Runoff = 0.23 cfs @ 12.30 hrs, Volume= 0.042 af, Depth= 0.49"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-30.00 hrs, dt= 0.01 hrs
Type III 24-hr 25-Year Rainfall=5.45"

	Area (sf)	CN	Description
*	30,771	39	>75% Grass cover, Good, HSG A
	8,235	36	Woods, Fair, HSG A
*	5,518	76	Gravel roads, HSG A
	44,524	43	Weighted Average
	44,524		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, Assumed

Subcatchment 13S: P-100 - Undeveloped Area

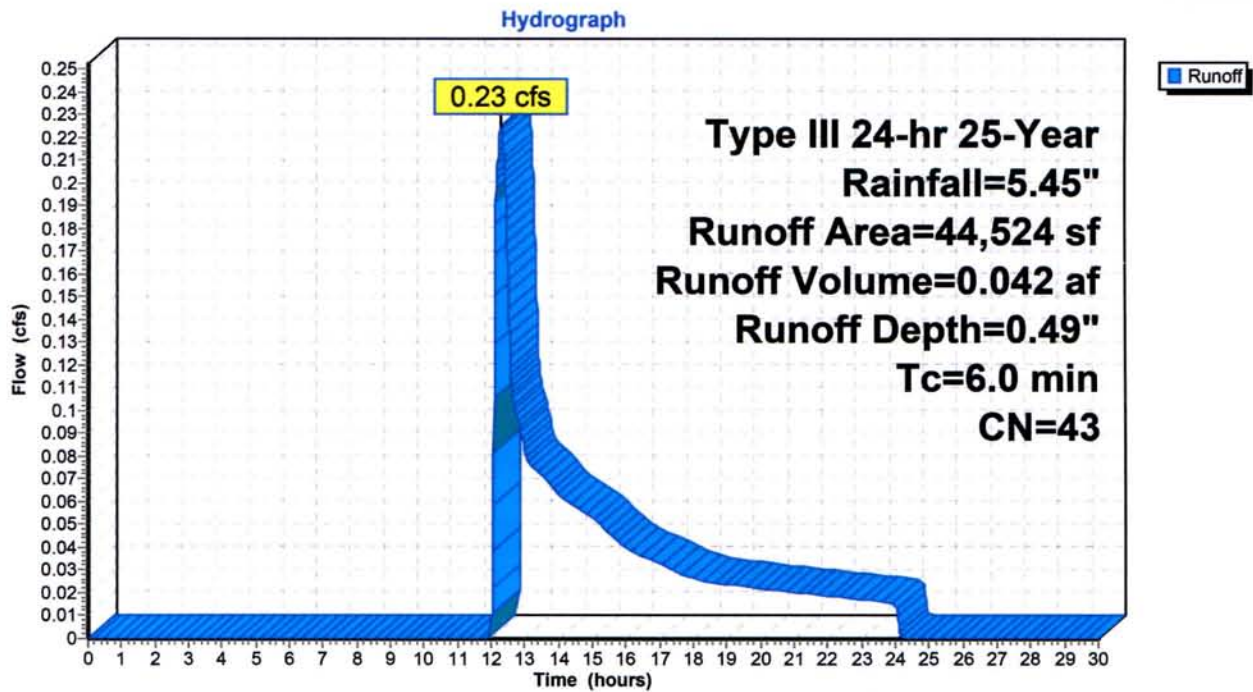

Proposed Conditions

Prepared by Allen & Major Associates

HydroCAD® 9.10 s/n 02881 © 2009 HydroCAD Software Solutions LLC

Post-Development Condition
Type III 24-hr 25-Year Rainfall=5.45"

Printed 8/3/2012

Page 36

Summary for Subcatchment 15S: P-100 - WS-Bldg

Existing watershed at Equipment Service station

Runoff = 0.17 cfs @ 12.08 hrs, Volume= 0.013 af, Depth= 5.21"


Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-30.00 hrs, dt= 0.01 hrs
Type III 24-hr 25-Year Rainfall=5.45"

Area (sf)	CN	Description
* 1,350	98	Buildings and Roadway
1,350		100.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, Assumed

Subcatchment 15S: P-100 - WS-Bldg

Hydrograph

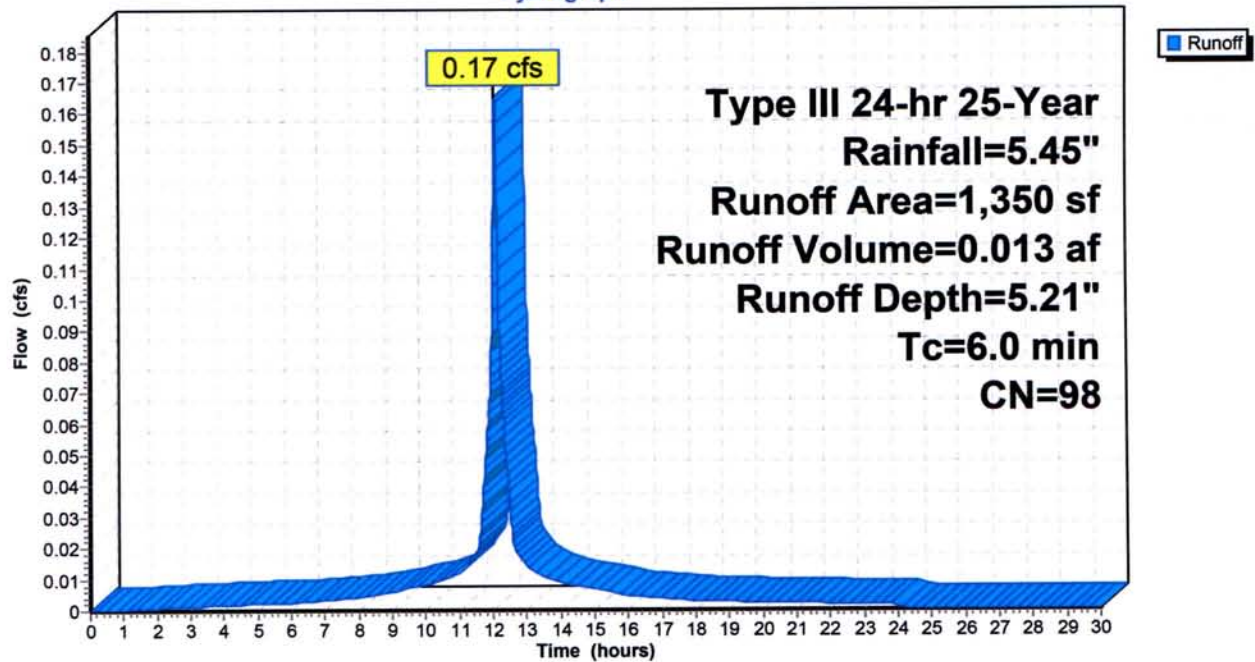

Proposed Conditions

Prepared by Allen & Major Associates

HydroCAD® 9.10 s/n 02881 © 2009 HydroCAD Software Solutions LLC

Post-Development Condition
Type III 24-hr 25-Year Rainfall=5.45"

Printed 8/3/2012

Page 37

Summary for Pond 14P: UDS 1

Inflow Area = 0.031 ac, 100.00% Impervious, Inflow Depth = 5.21" for 25-Year event
Inflow = 0.17 cfs @ 12.08 hrs, Volume= 0.013 af
Outflow = 0.05 cfs @ 12.41 hrs, Volume= 0.013 af, Atten= 71%, Lag= 19.7 min
Discarded = 0.05 cfs @ 12.41 hrs, Volume= 0.013 af

Routing by Stor-Ind method, Time Span= 0.00-30.00 hrs, dt= 0.01 hrs
Peak Elev= 88.00' @ 12.41 hrs Surf.Area= 0.002 ac Storage= 0.003 af

Plug-Flow detention time= 16.7 min calculated for 0.013 af (100% of inflow)
Center-of-Mass det. time= 16.7 min (763.3 - 746.6)

Volume	Invert	Avail.Storage	Storage Description
#1A	85.94'	0.002 af	6.25'W x 16.24'L x 3.50'H Field A 0.008 af Overall - 0.002 af Embedded = 0.006 af x 40.0% Voids
#2A	86.44'	0.002 af	StormTech SC-740 x 2 Inside #1 Effective Size= 44.6"W x 30.0"H => 6.45 sf x 7.12'L = 45.9 cf Overall Size= 51.0"W x 30.0"H x 7.56'L with 0.44' Overlap
		0.005 af	Total Available Storage

Storage Group A created with Chamber Wizard

Device	Routing	Invert	Outlet Devices
#1	Discarded	85.94'	8.270 in/hr Exfiltration over Surface area Conductivity to Groundwater Elevation = 84.50'

Discarded OutFlow Max=0.05 cfs @ 12.41 hrs HW=88.00' (Free Discharge)
↑1=Exfiltration (Controls 0.05 cfs)

Proposed Conditions

Prepared by Allen & Major Associates

HydroCAD® 9.10 s/n 02881 © 2009 HydroCAD Software Solutions LLC

Post-Development Condition

Type III 24-hr 25-Year Rainfall=5.45"

Printed 8/3/2012

Page 38

Pond 14P: UDS 1 - Chamber Wizard Field A

Chamber Model = StormTech SC-740

Effective Size= 44.6"W x 30.0"H => 6.45 sf x 7.12'L = 45.9 cf

Overall Size= 51.0"W x 30.0"H x 7.56'L with 0.44' Overlap

51.0" Wide + 6.0" Spacing = 57.0" C-C

2 Chambers/Row x 7.12' Long = 14.24' + 12.0" End Stone x 2 = 16.24' Base Length

1 Rows x 51.0" Wide + 12.0" Side Stone x 2 = 6.25' Base Width

6.0" Base + 30.0" Chamber Height + 6.0" Cover = 3.50' Field Height

2 Chambers x 45.9 cf = 91.9 cf Chamber Storage



355.2 cf Field - 91.9 cf Chambers = 263.4 cf Stone x 40.0% Voids = 105.3 cf Stone Storage

Stone + Chamber Storage = 197.2 cf = 0.005 af

2 Chambers

13.2 cy Field

9.8 cy Stone

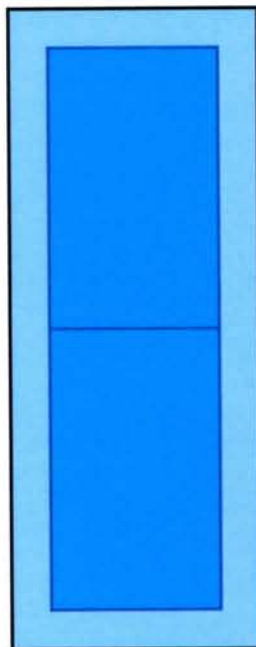

Proposed Conditions

Prepared by Allen & Major Associates

HydroCAD® 9.10 s/n 02881 © 2009 HydroCAD Software Solutions LLC


Post-Development Condition
Type III 24-hr 25-Year Rainfall=5.45"

Printed 8/3/2012

Page 39

Pond 14P: UDS 1

Hydrograph

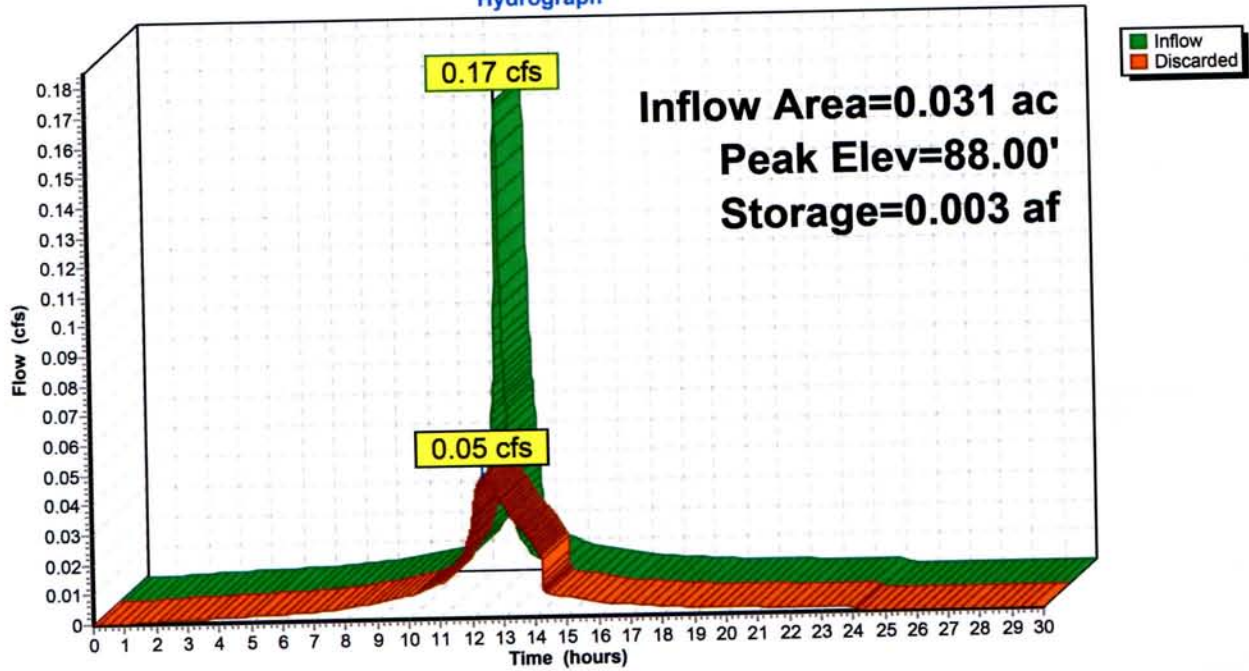

Proposed Conditions

Prepared by Allen & Major Associates
HydroCAD® 9.10 s/n 02881 © 2009 HydroCAD Software Solutions LLC

Post-Development Condition
Type III 24-hr 25-Year Rainfall=5.45"
Printed 8/3/2012
Page 40

Summary for Pond 17P: Water Quality Swale

Inflow Area = 1.022 ac, 0.00% Impervious, Inflow Depth = 0.49" for 25-Year event
Inflow = 0.23 cfs @ 12.30 hrs, Volume= 0.042 af
Outflow = 0.22 cfs @ 12.32 hrs, Volume= 0.042 af, Atten= 0%, Lag= 0.8 min
Discarded = 0.22 cfs @ 12.32 hrs, Volume= 0.042 af
Primary = 0.00 cfs @ 12.32 hrs, Volume= 0.000 af

Routing by Stor-Ind method, Time Span= 0.00-30.00 hrs, dt= 0.01 hrs
Peak Elev= 85.00' @ 12.32 hrs Surf.Area= 0.027 ac Storage= 0.000 af

Plug-Flow detention time= 0.9 min calculated for 0.042 af (100% of inflow)
Center-of-Mass det. time= 0.9 min (946.3 - 945.4)

Volume	Invert	Avail.Storage	Storage Description
#1	85.00'	1,078.500 af	Custom Stage Data (Prismatic) Listed below (Recalc)
Elevation (feet)	Surf.Area (acres)	Inc.Store (acre-feet)	Cum.Store (acre-feet)
85.00	0.000	0.000	0.000
86.00	298.000	149.000	149.000
87.00	1,561.000	929.500	1,078.500

Device	Routing	Invert	Outlet Devices
#1	Discarded	85.00'	8.270 in/hr Exfiltration over Surface area
#2	Primary	84.00'	0.1" Round Culvert L= 10.0' CPP, projecting, no headwall, Ke= 0.900 Inlet / Outlet Invert= 84.00' / 83.90' S= 0.0100 ' /' Cc= 0.900 n= 0.009 PVC, smooth interior

Discarded OutFlow Max=0.22 cfs @ 12.32 hrs HW=85.00' (Free Discharge)
↳ **1=Exfiltration** (Exfiltration Controls 0.22 cfs)

Primary OutFlow Max=0.00 cfs @ 12.32 hrs HW=85.00' (Free Discharge)
↳ **2=Culvert** (Barrel Controls 0.00 cfs @ 0.88 fps)

Proposed Conditions

Prepared by Allen & Major Associates

HydroCAD® 9.10 s/n 02881 © 2009 HydroCAD Software Solutions LLC

Post-Development Condition


Type III 24-hr 25-Year Rainfall=5.45"

Printed 8/3/2012

Page 41

Pond 17P: Water Quality Swale

Hydrograph

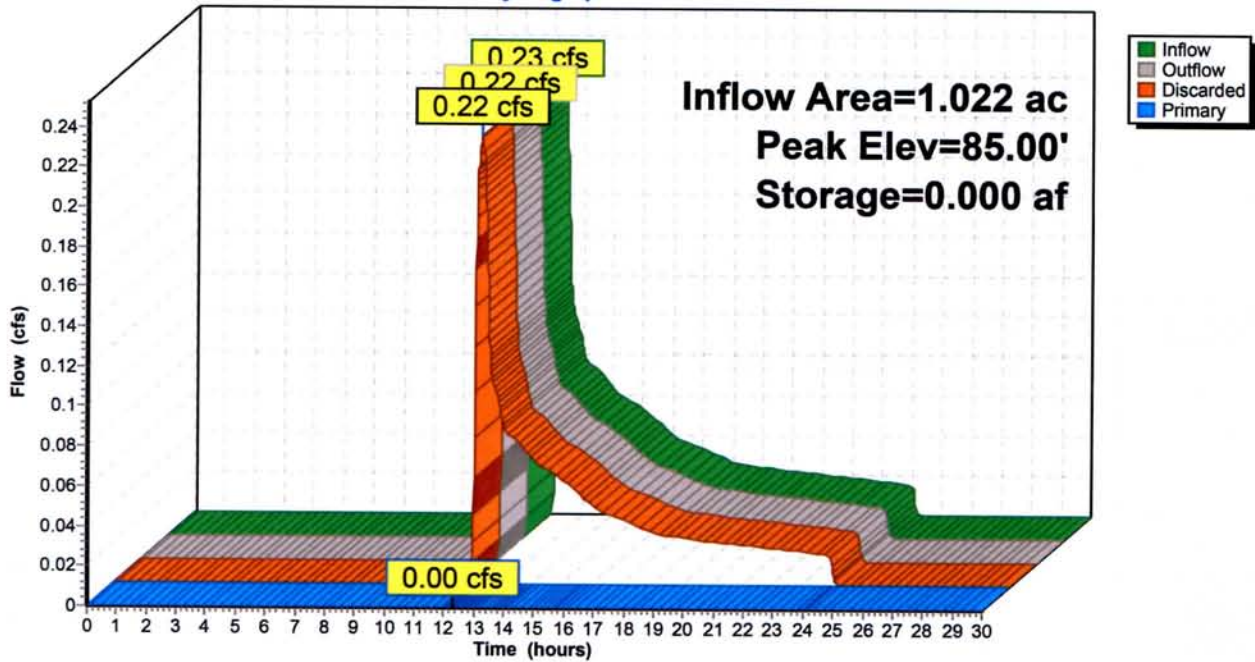

Proposed Conditions

Prepared by Allen & Major Associates

HydroCAD® 9.10 s/n 02881 © 2009 HydroCAD Software Solutions LLC

Post-Development Condition
Type III 24-hr 25-Year Rainfall=5.45"

Printed 8/3/2012

Page 42


Summary for Link 16L: (new Link)

Inflow Area = 1.053 ac, 2.94% Impervious, Inflow Depth = 0.00" for 25-Year event
Inflow = 0.00 cfs @ 12.32 hrs, Volume= 0.000 af
Primary = 0.00 cfs @ 12.32 hrs, Volume= 0.000 af, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-30.00 hrs, dt= 0.01 hrs

Link 16L: (new Link)

Hydrograph

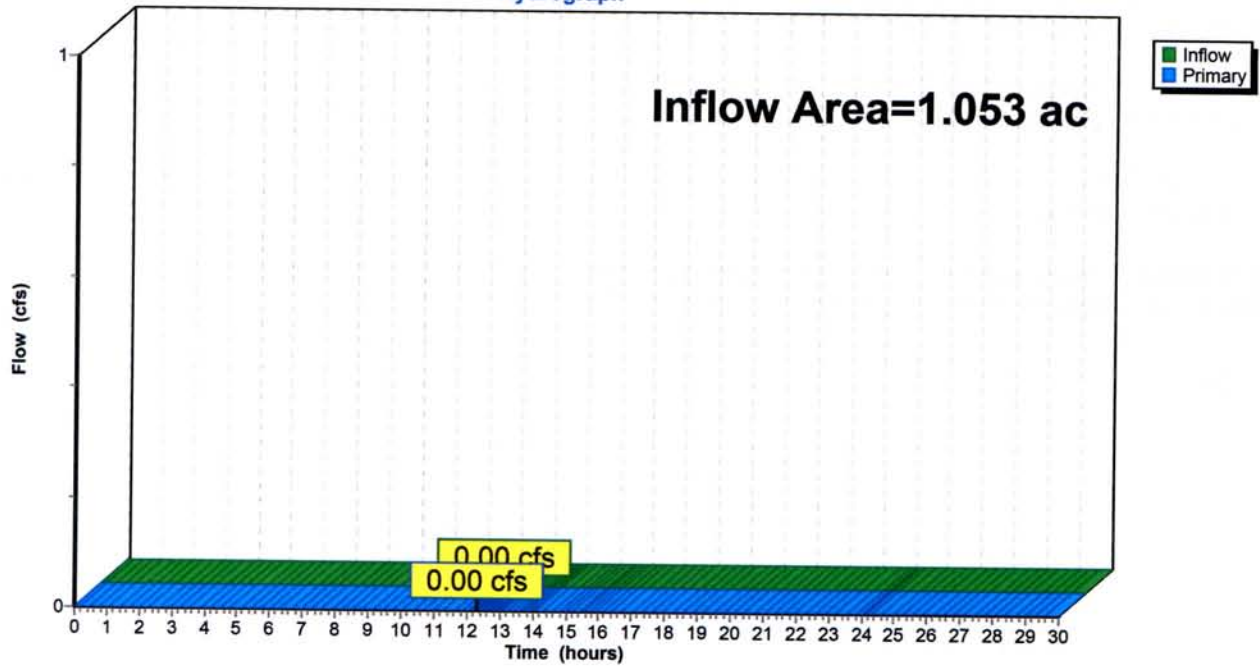

Proposed Conditions

Prepared by Allen & Major Associates

HydroCAD® 9.10 s/n 02881 © 2009 HydroCAD Software Solutions LLC

Post-Development Condition

Type III 24-hr 100-Year Rainfall=6.60"

Printed 8/3/2012

Page 43

Time span=0.00-30.00 hrs, dt=0.01 hrs, 3001 points

Runoff by SCS TR-20 method, UH=SCS

Reach routing by Stor-Ind+Trans method - Pond routing by Stor-Ind method

Subcatchment 13S: P-100 - Undeveloped Runoff Area=44,524 sf 0.00% Impervious Runoff Depth=0.91"
Tc=6.0 min CN=43 Runoff=0.67 cfs 0.077 af

Subcatchment 15S: P-100 - WS-Bldg Runoff Area=1,350 sf 100.00% Impervious Runoff Depth=6.36"
Tc=6.0 min CN=98 Runoff=0.20 cfs 0.016 af

Pond 14P: UDS 1 Peak Elev=88.66' Storage=0.004 af Inflow=0.20 cfs 0.016 af
Outflow=0.06 cfs 0.016 af

Pond 17P: Water Quality Swale Peak Elev=85.00' Storage=0.000 af Inflow=0.67 cfs 0.077 af
Discarded=0.66 cfs 0.077 af Primary=0.00 cfs 0.000 af Outflow=0.66 cfs 0.077 af

Link 16L: (new Link) Inflow=0.00 cfs 0.000 af
Primary=0.00 cfs 0.000 af

Total Runoff Area = 1.053 ac Runoff Volume = 0.094 af Average Runoff Depth = 1.07"
97.06% Pervious = 1.022 ac 2.94% Impervious = 0.031 ac

Proposed Conditions

Prepared by Allen & Major Associates

HydroCAD® 9.10 s/n 02881 © 2009 HydroCAD Software Solutions LLC

Post-Development Condition
Type III 24-hr 100-Year Rainfall=6.60"

Printed 8/3/2012

Page 44

Summary for Subcatchment 13S: P-100 - Undeveloped Area

Existing watershed at Equipment Service station


Runoff = 0.67 cfs @ 12.12 hrs, Volume= 0.077 af, Depth= 0.91"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-30.00 hrs, dt= 0.01 hrs
Type III 24-hr 100-Year Rainfall=6.60"

	Area (sf)	CN	Description
*	30,771	39	>75% Grass cover, Good, HSG A
	8,235	36	Woods, Fair, HSG A
*	5,518	76	Gravel roads, HSG A
	44,524	43	Weighted Average
	44,524		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, Assumed

Subcatchment 13S: P-100 - Undeveloped Area

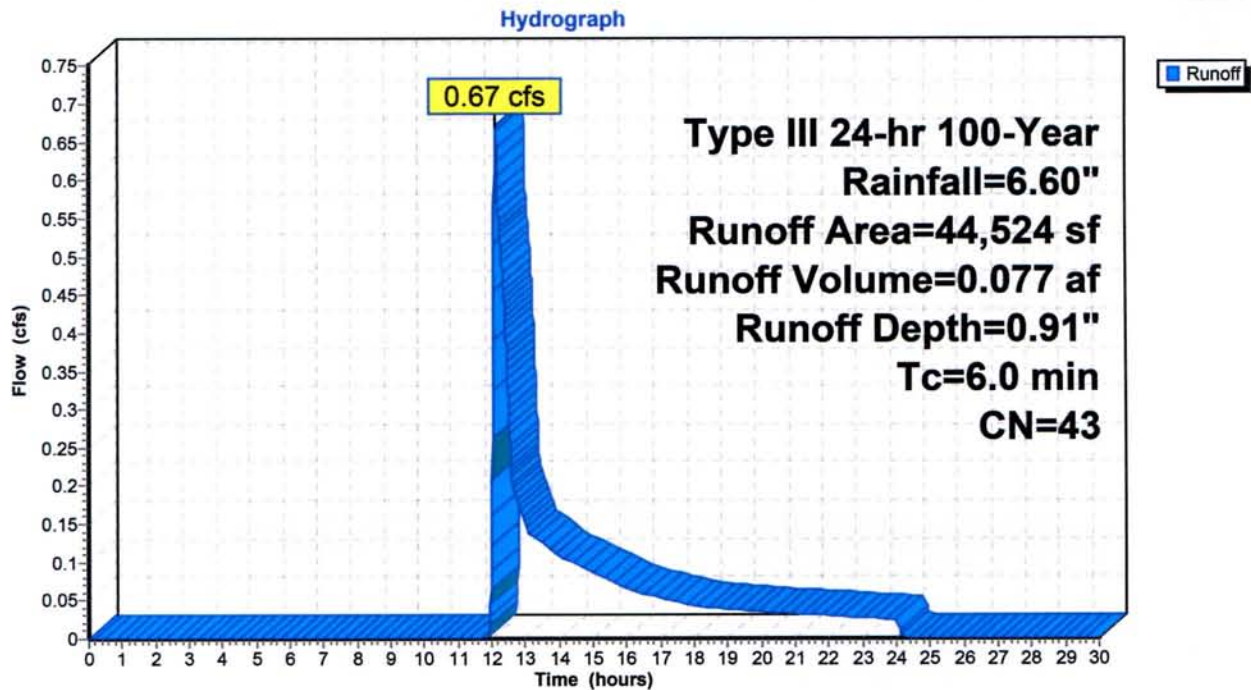

Proposed Conditions

Prepared by Allen & Major Associates

HydroCAD® 9.10 s/n 02881 © 2009 HydroCAD Software Solutions LLC

Post-Development Condition
Type III 24-hr 100-Year Rainfall=6.60"

Printed 8/3/2012

Page 44

Summary for Subcatchment 13S: P-100 - Undeveloped Area

Existing watershed at Equipment Service station


Runoff = 0.67 cfs @ 12.12 hrs, Volume= 0.077 af, Depth= 0.91"

Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-30.00 hrs, dt= 0.01 hrs
Type III 24-hr 100-Year Rainfall=6.60"

	Area (sf)	CN	Description
*	30,771	39	>75% Grass cover, Good, HSG A
	8,235	36	Woods, Fair, HSG A
*	5,518	76	Gravel roads, HSG A
	44,524	43	Weighted Average
	44,524		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, Assumed

Subcatchment 13S: P-100 - Undeveloped Area

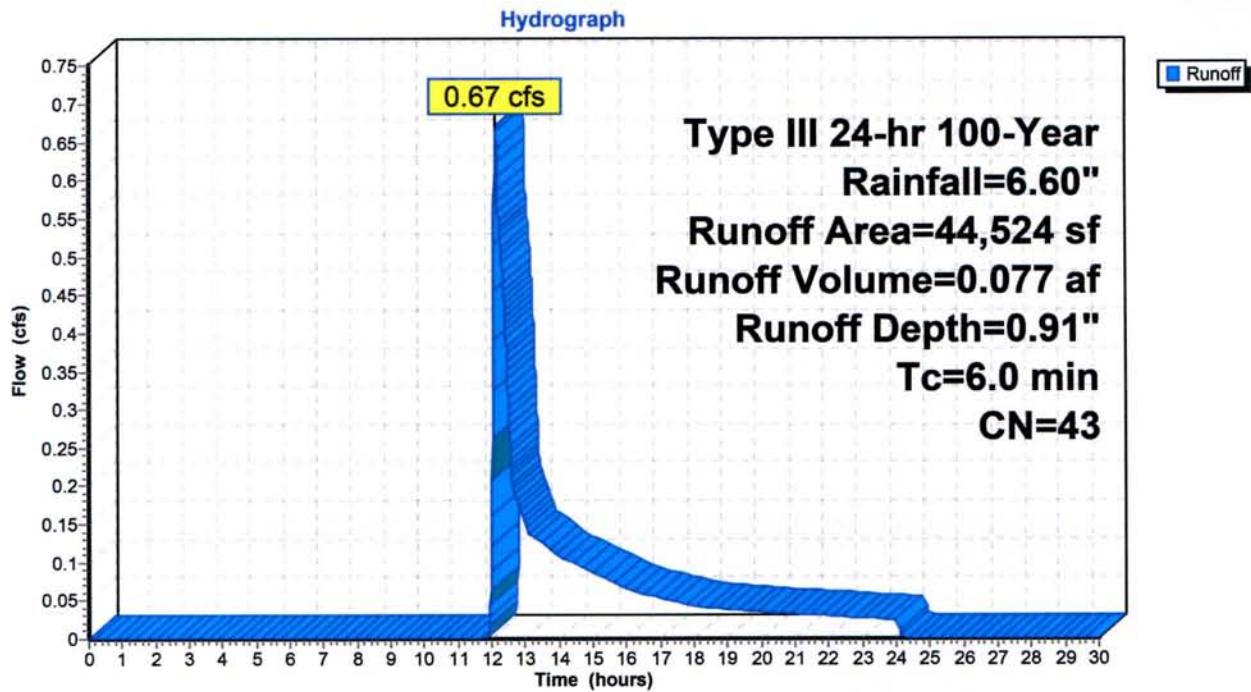

Proposed Conditions

Prepared by Allen & Major Associates

HydroCAD® 9.10 s/n 02881 © 2009 HydroCAD Software Solutions LLC

Post-Development Condition
Type III 24-hr 100-Year Rainfall=6.60"

Printed 8/3/2012

Page 45

Summary for Subcatchment 15S: P-100 - WS-Bldg

Existing watershed at Equipment Service station

Runoff = 0.20 cfs @ 12.08 hrs, Volume= 0.016 af, Depth= 6.36"


Runoff by SCS TR-20 method, UH=SCS, Time Span= 0.00-30.00 hrs, dt= 0.01 hrs
Type III 24-hr 100-Year Rainfall=6.60"

Area (sf)	CN	Description
* 1,350	98	Buildings and Roadway
1,350		100.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, Assumed

Subcatchment 15S: P-100 - WS-Bldg

Hydrograph

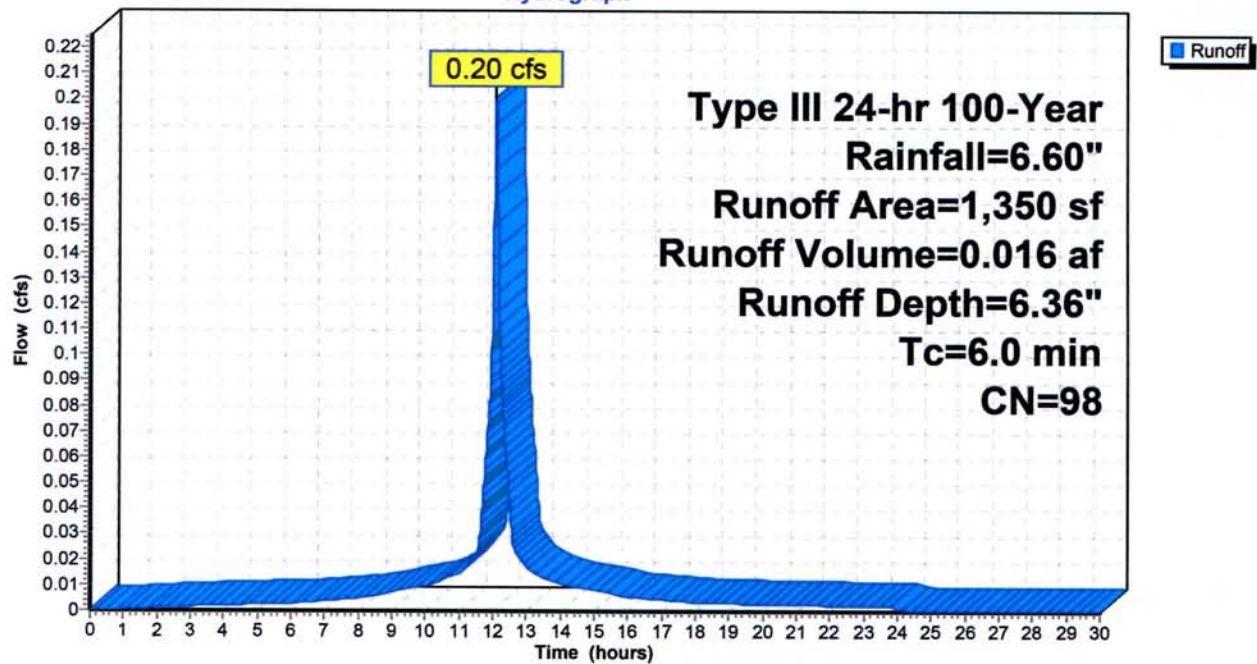

Proposed Conditions

Prepared by Allen & Major Associates

HydroCAD® 9.10 s/n 02881 © 2009 HydroCAD Software Solutions LLC

Post-Development Condition
Type III 24-hr 100-Year Rainfall=6.60"

Printed 8/3/2012

Page 46

Summary for Pond 14P: UDS 1

Inflow Area = 0.031 ac, 100.00% Impervious, Inflow Depth = 6.36" for 100-Year event
 Inflow = 0.20 cfs @ 12.08 hrs, Volume= 0.016 af
 Outflow = 0.06 cfs @ 12.42 hrs, Volume= 0.016 af, Atten= 72%, Lag= 20.1 min
 Discarded = 0.06 cfs @ 12.42 hrs, Volume= 0.016 af

Routing by Stor-Ind method, Time Span= 0.00-30.00 hrs, dt= 0.01 hrs
 Peak Elev= 88.66' @ 12.42 hrs Surf.Area= 0.002 ac Storage= 0.004 af

Plug-Flow detention time= 19.6 min calculated for 0.016 af (100% of inflow)
 Center-of-Mass det. time= 19.6 min (763.4 - 743.8)

Volume	Invert	Avail.Storage	Storage Description
#1A	85.94'	0.002 af	6.25'W x 16.24'L x 3.50'H Field A 0.008 af Overall - 0.002 af Embedded = 0.006 af x 40.0% Voids
#2A	86.44'	0.002 af	StormTech SC-740 x 2 Inside #1 Effective Size= 44.6"W x 30.0"H => 6.45 sf x 7.12'L = 45.9 cf Overall Size= 51.0"W x 30.0"H x 7.56'L with 0.44' Overlap
		0.005 af	Total Available Storage

Storage Group A created with Chamber Wizard

Device	Routing	Invert	Outlet Devices
#1	Discarded	85.94'	8.270 in/hr Exfiltration over Surface area Conductivity to Groundwater Elevation = 84.50'

Discarded OutFlow Max=0.06 cfs @ 12.42 hrs HW=88.66' (Free Discharge)
 ↑1=Exfiltration (Controls 0.06 cfs)

Proposed Conditions

Prepared by Allen & Major Associates

HydroCAD® 9.10 s/n 02881 © 2009 HydroCAD Software Solutions LLC

Post-Development Condition
Type III 24-hr 100-Year Rainfall=6.60"

Printed 8/3/2012

Page 47

Pond 14P: UDS 1 - Chamber Wizard Field A

Chamber Model = StormTech SC-740

Effective Size= 44.6"W x 30.0"H => 6.45 sf x 7.12'L = 45.9 cf

Overall Size= 51.0"W x 30.0"H x 7.56'L with 0.44' Overlap

51.0" Wide + 6.0" Spacing = 57.0" C-C

2 Chambers/Row x 7.12' Long = 14.24' + 12.0" End Stone x 2 = 16.24' Base Length

1 Rows x 51.0" Wide + 12.0" Side Stone x 2 = 6.25' Base Width

6.0" Base + 30.0" Chamber Height + 6.0" Cover = 3.50' Field Height

2 Chambers x 45.9 cf = 91.9 cf Chamber Storage



355.2 cf Field - 91.9 cf Chambers = 263.4 cf Stone x 40.0% Voids = 105.3 cf Stone Storage

Stone + Chamber Storage = 197.2 cf = 0.005 af

2 Chambers

13.2 cy Field

9.8 cy Stone

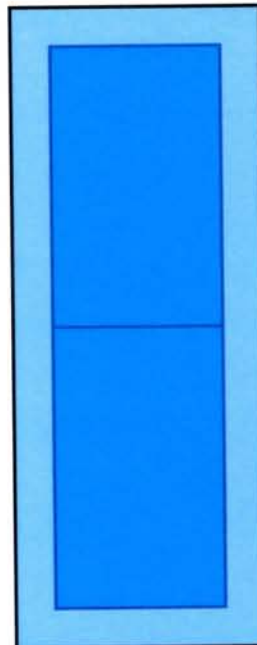

Proposed Conditions

Prepared by Allen & Major Associates

HydroCAD® 9.10 s/n 02881 © 2009 HydroCAD Software Solutions LLC

Post-Development Condition


Type III 24-hr 100-Year Rainfall=6.60"

Printed 8/3/2012

Page 48

Pond 14P: UDS 1

Hydrograph

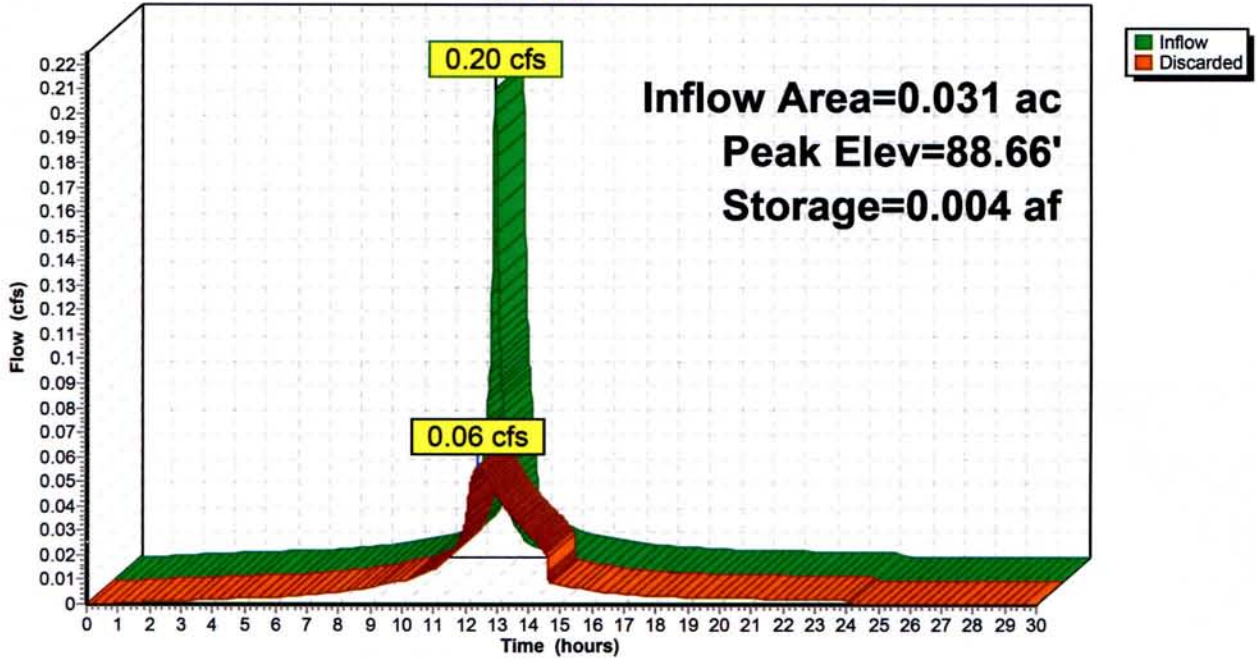

Proposed Conditions

Prepared by Allen & Major Associates
HydroCAD® 9.10 s/n 02881 © 2009 HydroCAD Software Solutions LLC

Post-Development Condition
Type III 24-hr 100-Year Rainfall=6.60"
Printed 8/3/2012
Page 49

Summary for Pond 17P: Water Quality Swale

Inflow Area = 1.022 ac, 0.00% Impervious, Inflow Depth = 0.91" for 100-Year event
Inflow = 0.67 cfs @ 12.12 hrs, Volume= 0.077 af
Outflow = 0.66 cfs @ 12.14 hrs, Volume= 0.077 af, Atten= 2%, Lag= 1.0 min
Discarded = 0.66 cfs @ 12.14 hrs, Volume= 0.077 af
Primary = 0.00 cfs @ 12.14 hrs, Volume= 0.000 af

Routing by Stor-Ind method, Time Span= 0.00-30.00 hrs, dt= 0.01 hrs
Peak Elev= 85.00' @ 12.14 hrs Surf.Area= 0.079 ac Storage= 0.000 af

Plug-Flow detention time= 0.9 min calculated for 0.077 af (100% of inflow)
Center-of-Mass det. time= 0.9 min (916.3 - 915.4)

Volume	Invert	Avail.Storage	Storage Description
#1	85.00'	1,078.500 af	Custom Stage Data (Prismatic) Listed below (Recalc)
Elevation (feet)	Surf.Area (acres)	Inc.Store (acre-feet)	Cum.Store (acre-feet)
85.00	0.000	0.000	0.000
86.00	298.000	149.000	149.000
87.00	1,561.000	929.500	1,078.500

Device	Routing	Invert	Outlet Devices
#1	Discarded	85.00'	8.270 in/hr Exfiltration over Surface area
#2	Primary	84.00'	0.1" Round Culvert L= 10.0' CPP, projecting, no headwall, Ke= 0.900 Inlet / Outlet Invert= 84.00' / 83.90' S= 0.0100 '/' Cc= 0.900 n= 0.009 PVC, smooth interior

Discarded OutFlow Max=0.66 cfs @ 12.14 hrs HW=85.00' (Free Discharge)
↳ **1=Exfiltration** (Exfiltration Controls 0.66 cfs)

Primary OutFlow Max=0.00 cfs @ 12.14 hrs HW=85.00' (Free Discharge)
↳ **2=Culvert** (Barrel Controls 0.00 cfs @ 0.88 fps)

Proposed Conditions

Prepared by Allen & Major Associates

HydroCAD® 9.10 s/n 02881 © 2009 HydroCAD Software Solutions LLC

Post-Development Condition


Type III 24-hr 100-Year Rainfall=6.60"

Printed 8/3/2012

Page 50

Pond 17P: Water Quality Swale

Hydrograph

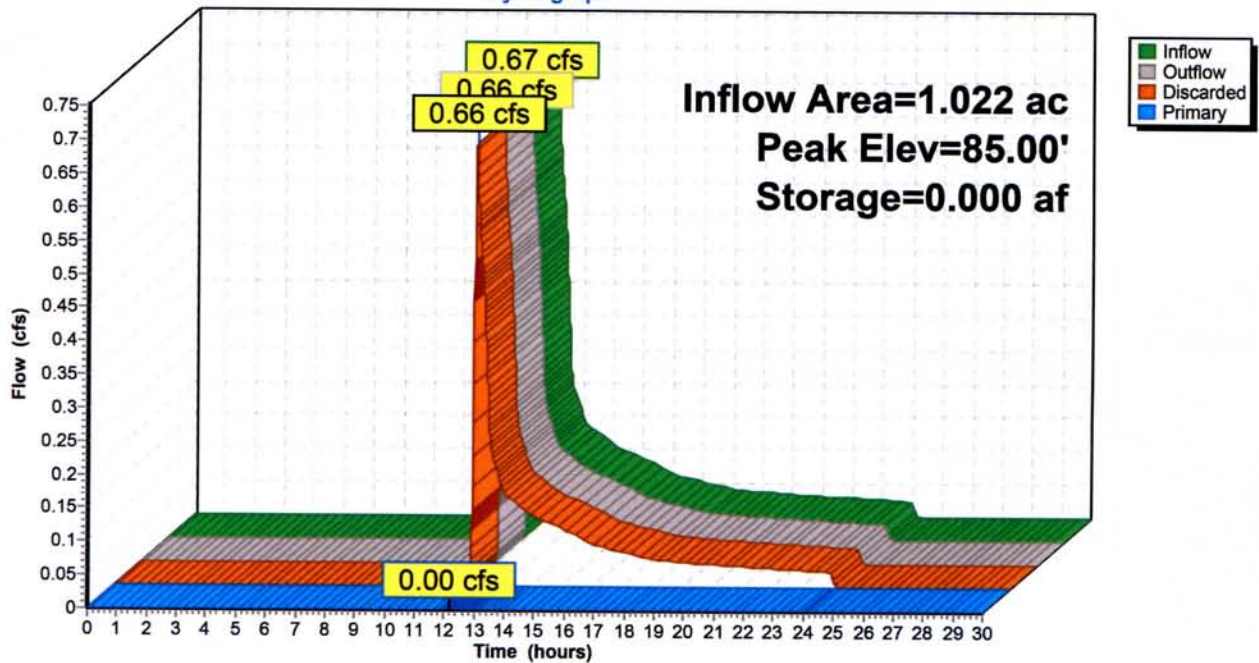

Proposed Conditions

Prepared by Allen & Major Associates

HydroCAD® 9.10 s/n 02881 © 2009 HydroCAD Software Solutions LLC

Post-Development Condition
Type III 24-hr 100-Year Rainfall=6.60"

Printed 8/3/2012

Page 51


Summary for Link 16L: (new Link)

Inflow Area = 1.053 ac, 2.94% Impervious, Inflow Depth = 0.00" for 100-Year event
Inflow = 0.00 cfs @ 12.14 hrs, Volume= 0.000 af
Primary = 0.00 cfs @ 12.14 hrs, Volume= 0.000 af, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-30.00 hrs, dt= 0.01 hrs

Link 16L: (new Link)

Hydrograph

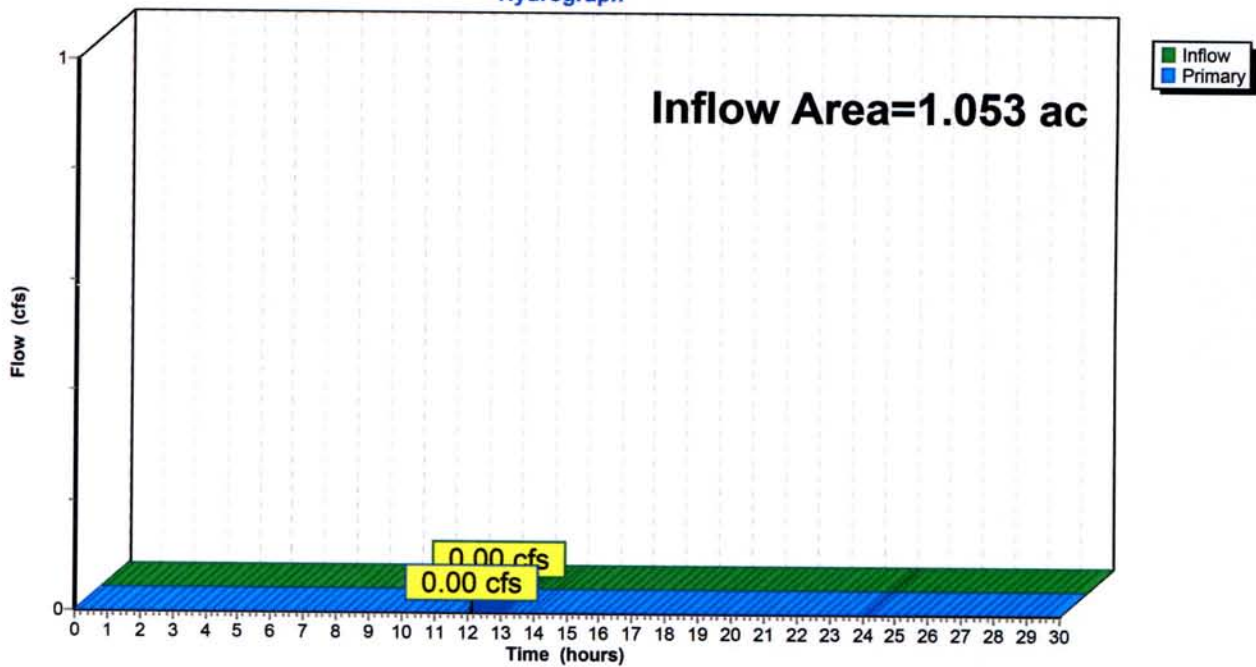

5 Appendix

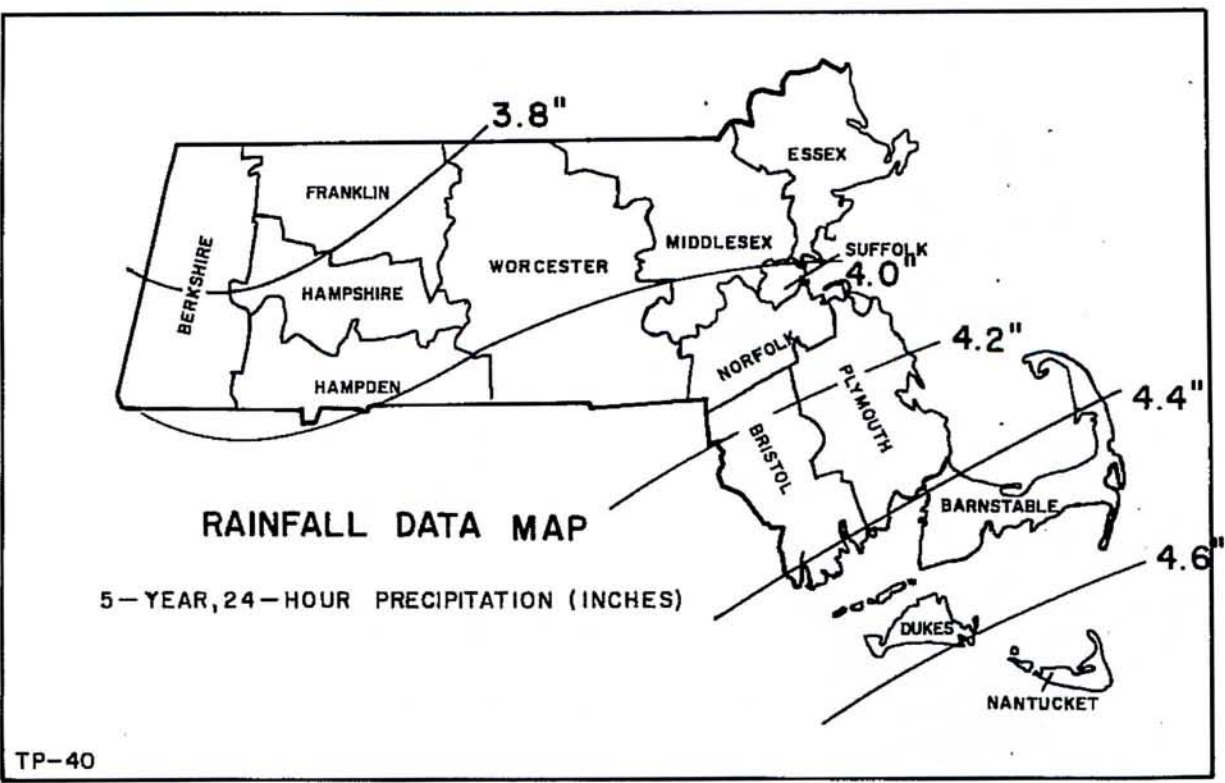
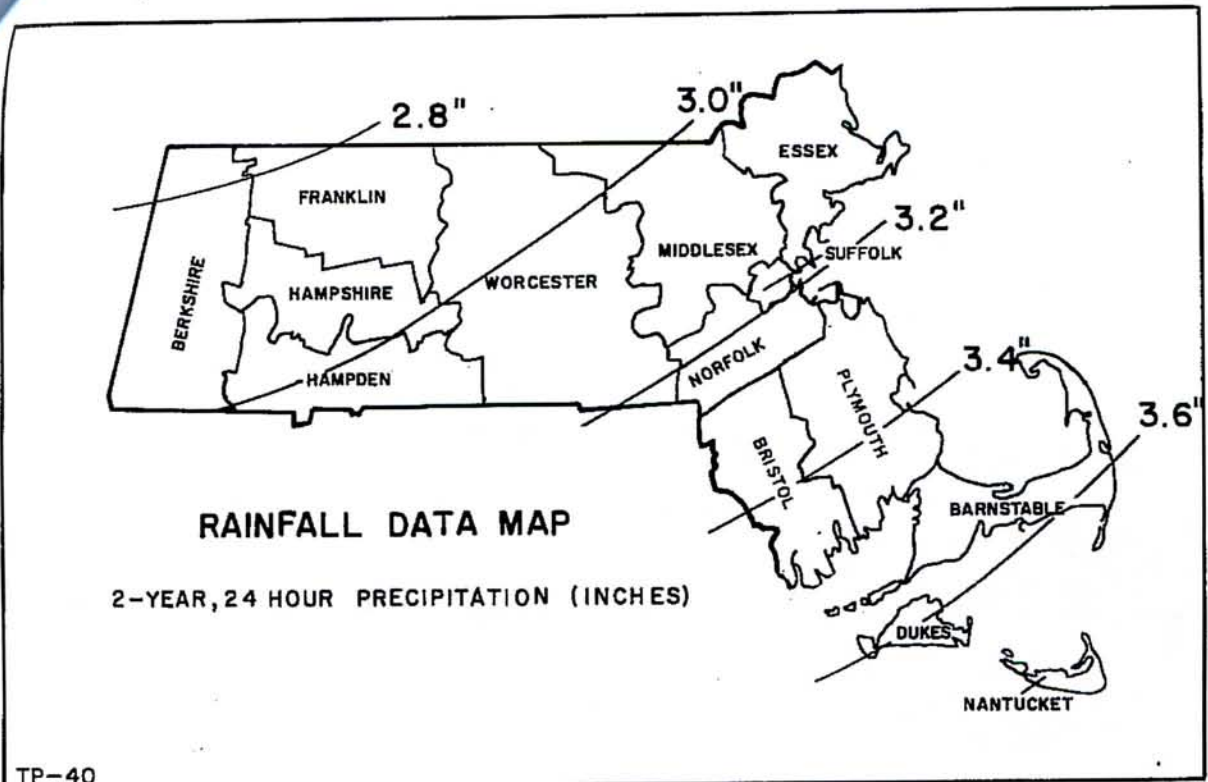


FIGURE B-1, SHEET 1 OF 3

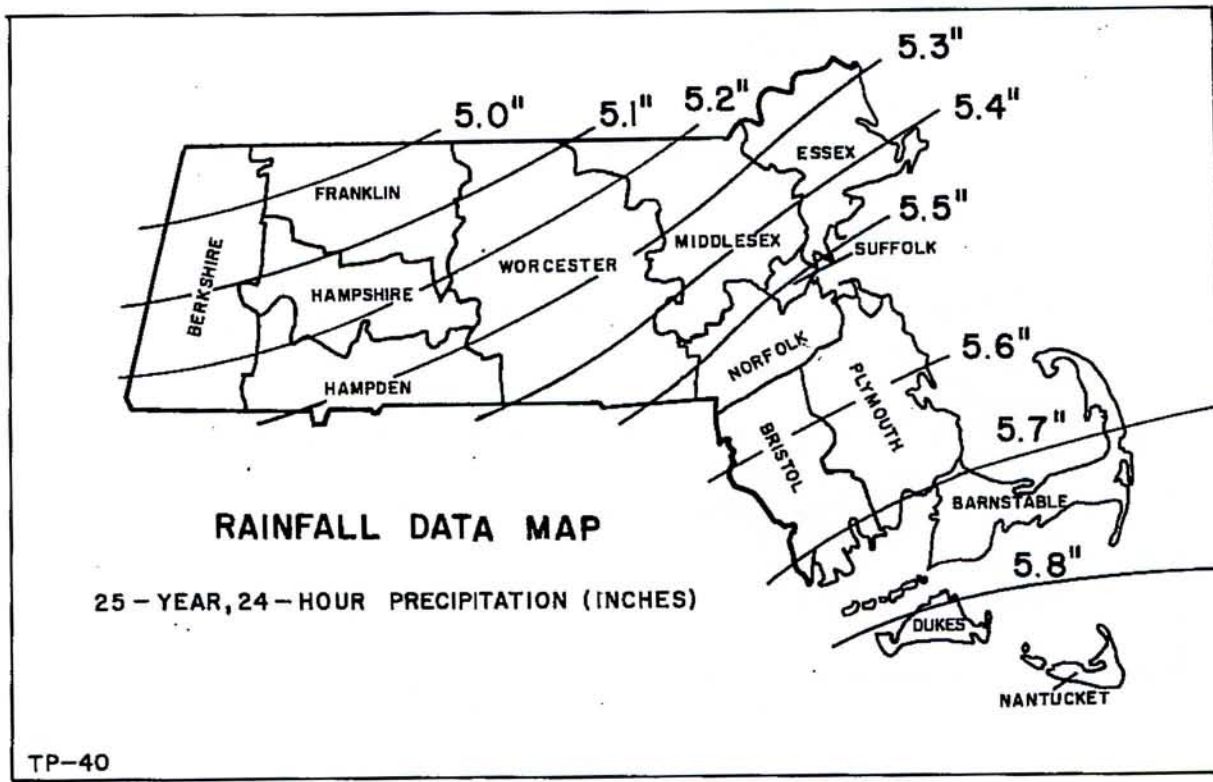
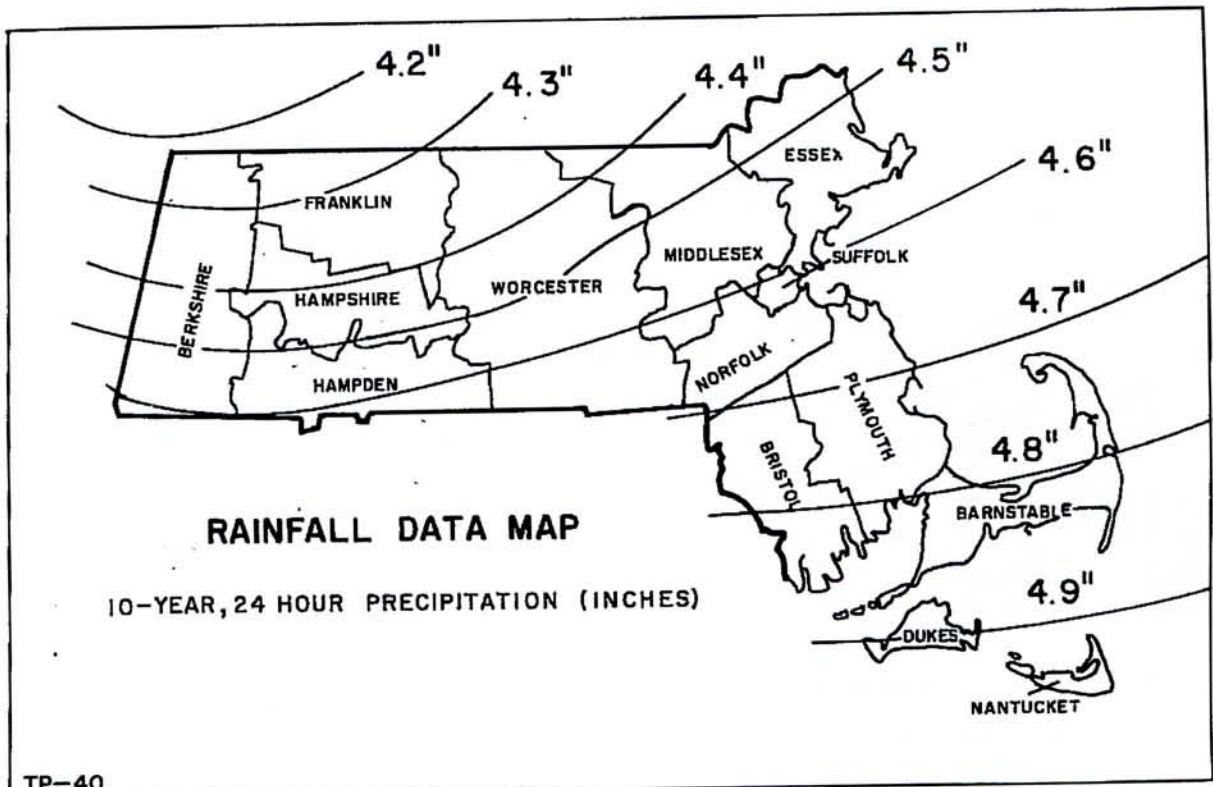


FIGURE B-1, SHEET 2 OF 3

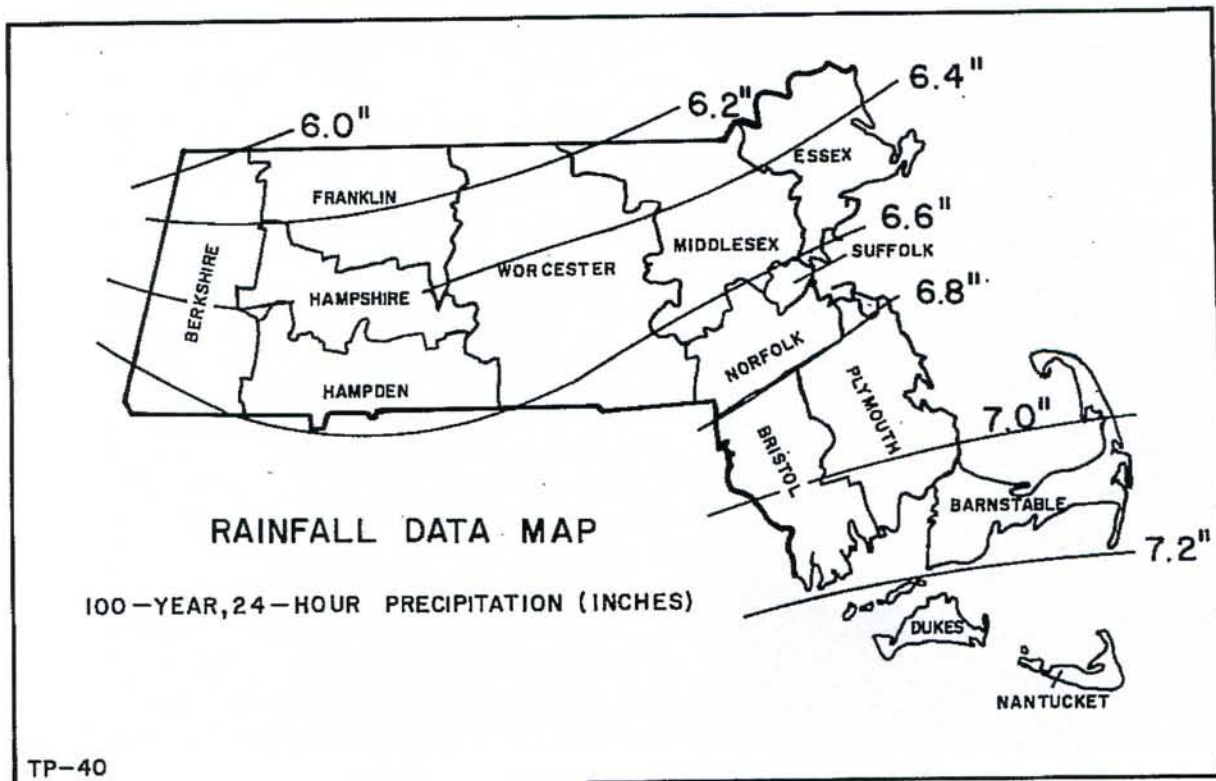
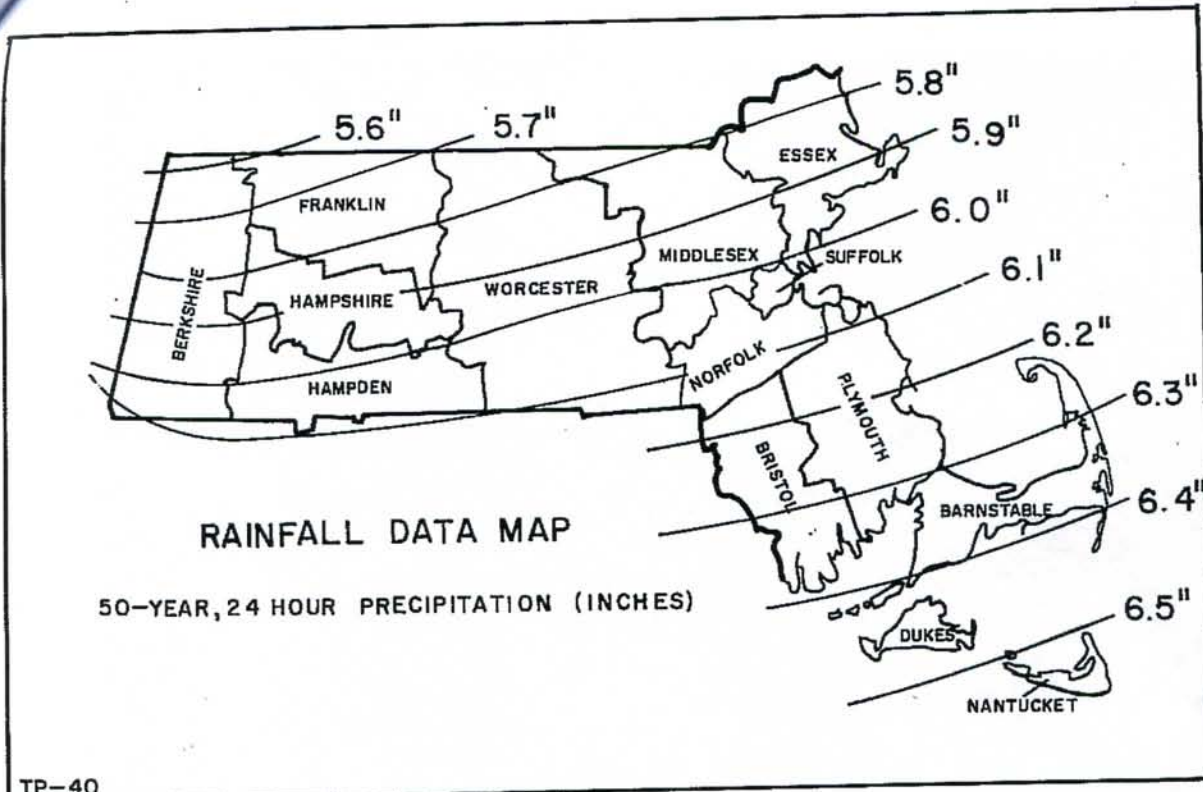


FIGURE B-1, SHEET 3 OF 3

MAP INFORMATION

Map Scale: 1:8,630 if printed on A size (8.5" x 11") sheet.
The soil surveys that comprise your AOI were mapped at 1:25,000.

Warning: Soil Map may not be valid at this scale.
Enlargement of maps beyond the scale of mapping can cause misunderstanding of the detail of mapping and accuracy of soil line placement. The maps do not show the small areas of contrasting soils that could have been shown at a more detailed scale.

Please rely on the bar scale on each map sheet for accurate map measurements.

Source of Map: Natural Resources Conservation Service
Web Soil Survey URL: <http://websoilsurvey.nrcs.usda.gov>
Coordinate System: UTM Zone 19N NAD83


















This product is generated from the USDA-NRCS certified data as of the version date(s) listed below.

Soil Survey Area: Norfolk and Suffolk Counties, Massachusetts
Survey Area Data: Version 8, Jul 23, 2010

Date(s) aerial images were photographed: 7/10/2003

The orthophoto or other base map on which the soil lines were compiled and digitized probably differs from the background imagery displayed on these maps. As a result, some minor shifting of map unit boundaries may be evident.

MAP LEGEND

- Area of Interest (AOI)**
 Area of Interest (AOI)
- Soils**
 Soil Map Units
- Soil Ratings**
-  A
 -  A/D
 -  B
 -  B/D
 -  C
 -  C/D
 -  D
 -  Not rated or not available
- Political Features**
 Cities
- Water Features**
 Streams and Canals
- Transportation**
-  Rails
 -  Interstate Highways
 -  US Routes
 -  Major Roads
 -  Local Roads

Hydrologic Soil Group

Hydrologic Soil Group— Summary by Map Unit — Norfolk and Suffolk Counties, Massachusetts (MA616)				
Map unit symbol	Map unit name	Rating	Acres in AOI	Percent of AOI
1	Water		1.2	0.6%
30	Raynham silt loam, 0 to 3 percent slopes	C	10.7	5.8%
51	Swansea muck, 0 to 1 percent slopes	D	0.2	0.1%
223B	Scio very fine sandy loam, 2 to 5 percent slopes	B	5.4	2.9%
245B	Hinckley sandy loam, 3 to 8 percent slopes	A	25.7	13.8%
245C	Hinckley sandy loam, 8 to 15 percent slopes	A	63.4	34.1%
253D	Hinckley loamy sand, 15 to 35 percent slopes	A	15.1	8.1%
254B	Merrimac fine sandy loam, 3 to 8 percent slopes	A	15.2	8.2%
260B	Sudbury fine sandy loam, 2 to 8 percent slopes	B	26.7	14.4%
305C	Paxton fine sandy loam, 8 to 15 percent slopes	C	0.2	0.1%
310B	Woodbridge fine sandy loam, 3 to 8 percent slopes	C	0.5	0.2%
420B	Canton fine sandy loam, 3 to 8 percent slopes	B	0.5	0.3%
602	Urban land, 0 to 15 percent slopes		4.8	2.6%
626B	Merrimac-Urban land complex, 0 to 8 percent slopes	A	7.7	4.1%
653	Udorthents, sandy	B	8.8	4.7%
Totals for Area of Interest			186.0	100.0%

Description

Hydrologic soil groups are based on estimates of runoff potential. Soils are assigned to one of four groups according to the rate of water infiltration when the soils are not protected by vegetation, are thoroughly wet, and receive precipitation from long-duration storms.

The soils in the United States are assigned to four groups (A, B, C, and D) and three dual classes (A/D, B/D, and C/D). The groups are defined as follows:

Group A. Soils having a high infiltration rate (low runoff potential) when thoroughly wet. These consist mainly of deep, well drained to excessively drained sands or gravelly sands. These soils have a high rate of water transmission.

Group B. Soils having a moderate infiltration rate when thoroughly wet. These consist chiefly of moderately deep or deep, moderately well drained or well drained soils that have moderately fine texture to moderately coarse texture. These soils have a moderate rate of water transmission.

Group C. Soils having a slow infiltration rate when thoroughly wet. These consist chiefly of soils having a layer that impedes the downward movement of water or soils of moderately fine texture or fine texture. These soils have a slow rate of water transmission.

Group D. Soils having a very slow infiltration rate (high runoff potential) when thoroughly wet. These consist chiefly of clays that have a high shrink-swell potential, soils that have a high water table, soils that have a claypan or clay layer at or near the surface, and soils that are shallow over nearly impervious material. These soils have a very slow rate of water transmission.

If a soil is assigned to a dual hydrologic group (A/D, B/D, or C/D), the first letter is for drained areas and the second is for undrained areas. Only the soils that in their natural condition are in group D are assigned to dual classes.

Rating Options

Aggregation Method: Dominant Condition

Component Percent Cutoff: None Specified

Tie-break Rule: Higher

A&M Job #: 1828-02
 Calc'd By: PLC
 Date: 8/9/2012

Open Channel flow

Side Slopes =	3.0	:1
Depth =	1.5	ft
Base =	2	ft
Cross Sectional Area, A =	9.8	sf
Wetted Perimeter =	11.5	ft
Hydraulic Radius, R =	0.8	ft
Channel Slope, S =	2.0%	
Mannings Roughness Coefficient, n =	0.24	
Velocity =	0.79	ft/sec
Required Flow =	unknown	cfs
Channel Capacity, Q =	7.73	cfs

$$V = \frac{1.49 \times (R^{2/3}) \times (S^{1/2})}{n}$$

$$Q = V \times A$$

Manning Coefficients, n	
Concrete, asphalt, gravel, bare soil	0.011
Fallow (no residue)	0.05
Cultivated Soils	0.06
- Residue Cover < 20%	0.17
- Residue Cover > 20%	
Grass	0.15
- Short Prairie Grass	0.24
- Dense Grass	0.41
- Bermuda Grass	
Range (natural)	0.13
Woods	0.4
- Light underbrush	0.8
- Dense underbrush	
Natural Channels	0.025
- Gravel Bed (Straight)	0.04
- Gravel Bed (large boulders)	

LEGAL NOTICE

TO BE PUBLISHED IN THE METROWEST DAILY
On Thursday, September 6, 2012

300 Wellesley Avenue

Town of Wellesley
WETLANDS PROTECTION COMMITTEE
NOTICE OF INTENT (REVISED)

Pursuant to the Mass. Wetlands Protection Act (MGL Ch.131s.40), and the Wellesley Wetlands Protection Bylaw (Article 44), a public meeting will be held by the Wellesley Wetlands Protection Committee at the Wellesley Police Station, 485 Washington Street, in the Kingsbury Room on September 13, 2012 at 8:05 to review a proposal by Martin Ryan, General Manager of the Wellesley Country Club to address changes to the Maintenance Facilities Project within a wetland buffer zone at 300 Wellesley Avenue. Plans are on file with the Wetlands Protection Committee and the Massachusetts Department of Environmental Protection.

Eric Seaborn, Chairperson

FOR NEWSPAPER USE ONLY

Bill to Applicant:

Wellesley Country Club
300 Wellesley Avenue
Wellesley, MA 02481
Attention: Martin Ryan, General Manager
781-235-7333 X 202

Telephone

FOR NRC OFFICE USE ONLY

cc: Wellesley Country Club.
Michael Toohill, Coneco Engineers & Scientists, Inc., 227 Chelmsford St., Ste. C,
Chelmsford, MA 01824
Building

0-11-12
11-1-12